

VM3

Molded Case Circuit Breaker





- Tailored for solar energy and wind power
- With higher breaking capacity
- With excellent anti damp heat and dew solidification capabilities
- Working voltage up to 1000V
- Strong ability to adapt to alternating changes in high and low temperatures
- High altitude adaptability

Ambient conditions

Operating ambient temperature/storage temperature

- Operating environment temperature: -40 °C~+70 °C, with an average value of no more than +35 °C within 24 hours
- Storage temperature: -40 °C~+75 °C

Altitude conditions

- Altitude of installation site ≤ 2000m (Over 2000 meters need capacity reduction for using)

Pollution level

- Level 3

Protection level

- Product protection level: IP20

Installation Category

- Class II (load) and Class III (distribution and control)

Installation Environment


- The product is installed in a medium without explosion risk, and the medium is not sufficient to corrode metal, there is no gas that damages the insulation layer of the product, there is no conductive dust, and it should be avoided from being used in places invaded by rain and snow

Environmental requirements

- The product meets RoHS standards

Electrical Characteristics

VM3 Series Molded Case Circuit Breaker (TMF)

Poles			
Control	Rotary handle operator		
	Motor-operated mechanism		
Connection	Wiring in front of the board		
	Wiring on back of the board		
	Plug-in		
	Draw-out		
IEC 60947-2			
Release rated current I_n (A)			
Rated insulation voltage(V)			U_i
Rated impulse withstand voltage(kV)			U_{imp}
Rated operating voltage(V)			U_e
Breaker Type			
Rated ultimate short circuit breaking capacity(kA)	I_{cu}	AC 50/60 Hz	400V
			500V
			690V
			800V
			1000V
Rated service short circuit breaking capacity(kA)	I_{cs}	AC 50/60 Hz	400V
			500V
			690V
			800V
			1000V
Utilization category			
Number of operation cycles	Machinery		
	Electrical	AC400V	
		AC500V	
		AC690V	
		AC800V	
		AC1000V	
Protection unit			
Protection unit			
Overload protection		Long time delay	$I_r (I_n \times \dots)$
Short-circuit protection		Instantaneous	$I_i (I_n \times \dots)$
Indication and control accessories			
Alarm switch(AL)			
Auxiliary switch(AX)			
Shunt release(SHT)			
Under-voltage release(UVT)			
Installation			
Accessories		Terminal	
		Phase separator	
Circuit breaker size(mm)			W
			L
			H

VM3-250HUL



3P
■
■
■
—
—
—
63, 80, 100, 125, 140, 160, 180, 200, 225, 250 AC1150
8
AC800
L
30
23
A
10000
1500
Thermal-Magnetic
■
■
■
■
■
■
116
200
107

VM3-250HUM



3P
■
■
■
—
—
—
63, 80, 100, 125, 140, 160, 180, 200, 225, 250 AC1150
8
AC800/AC1000
M
40
15
36.5
15
A
10000
1500
1000
Thermal-Magnetic
■
■
■
■
■
■
116
200
107


Note : 1.HUL,HUM,HUH type only provides front wiring of 3P;
2.The symbol "—" indicates that this option is not available; The symbol "■" indicates that this option is optional.

VM3 Series Molded Case Circuit Breaker (TMF)

VM3-250HUH

VM3-630HUL



Poles			
Control	Rotary handle operator		
	Motor-operated mechanism		
Connection	Wiring in front of the board		
	Wiring on back of the board		
	Plug-in		
	Draw-out		
IEC 60947-2			
Release rated current I_n (A)			
Rated insulation voltage(V)			U_i
Rated impulse withstand voltage(kV)			U_{imp}
Rated operating voltage(V)			U_e
Breaker Type			
Rated ultimate short circuit breaking capacity(kA)	I_{cu}	AC 50/60 Hz	400V
			500V
			690V
			800V
			1000V
Rated service short circuit breaking capacity(kA)	I_{cs}	AC 50/60 Hz	400V
			500V
			690V
			800V
			1000V
Utilization category			
Number of operation cycles	Machinery		
	Electrical	AC400V	
		AC500V	
		AC690V	
		AC800V	
		AC1000V	
Protection unit			
Protection unit			
Overload protection		Long time delay	$I_r (I_n \times \dots)$
Short-circuit protection		Instantaneous	$I_i (I_n \times \dots)$
Indication and control accessories			
Alarm switch(AL)			
Auxiliary switch(AX)			
Shunt release(SHT)			
Under-voltage release(UVT)			
Installation			
Accessories		Terminal	
		Phase separator	
Circuit breaker size(mm)			W
			L
			H

3P	■
■	■
■	■
—	—
—	—
—	—
63,80,100,125,140,160,180,200,225,250	
AC1150	
8	
AC800	
H	
50	
36.5	
A	
10000	
1500	
1000	
Thermal-Magnetic	
■	■
■	■
■	■
■	■
■	■
■	■
■	■
116	
200	
107	

3P	■
■	■
■	■
—	—
—	—
—	—
200,250,315,350,400	
AC1150	
8	
AC800/AC1000	
L	
36.5	
15	
36.5	
15	
A	
10000	
1500	
1000	
Thermal-Magnetic	
■	■
■	■
■	■
■	■
■	■
■	■
■	■
150	
257	
103	

Note : 1.HUL,HUM,HUH type only provides front wiring of 3P;

2.The symbol "-" indicates that this option is not available; The symbol "■" indicates that this option is optional.

VM3	–	250	HU	M	250	/	TMF	/	3	/	AX/SHT
1		2	3	4	5		6		7		8

SN	Name	Specification, type code	
1	Design code	VM3: Design code	
2	Frame rating	250: 250A 630: 630A	
3	High voltage type	HU: High voltage	
4	Breaking capacity	L, M, H	
5	Rated current	63~400A	
6	Protection unit type	TMF: Thermal magnetic protection unit (For power distribution protection)	
7	Number of poles	3P	
8	Accessories (separated with "/" between different accessories)	Connection accessories	Empty: Fixed type wiring in front of the board
		Electrical accessories	AL: Alarm contact AX: Auxiliary contact SHT: Shunt release UVT: Under-voltage release
		Control Accessories Note: VM3-630HU optional	CD2: Motor operator CS1: Manual operator CS2: Manual operator-eccentric CS3: Box-type manual operator eccentric SF: Rotary handle F type SR: Rotary handle R type

* Electrical accessories

Accessories	Voltage				
SHT Shunt release	AC230V	AC400V	DC220V	AC/DC110V	DC24V
UVT Under-voltage release	AC230V	AC400V			
Motor operator	AC110V	AC230V	DC110V	AC/DC220V	DC24V

If the accessory voltage and voltage control loop is inconsistent, please use indicate the accessory voltage after accessory.


Example

VM3-250HUL250/TMF/3/AX/SHT (AC230)

Meaning: VM3 series circuit breaker; the frame level is 250A; breaking capacity is 30kA, 3 poles; rated current is 250A; fixed type wiring on front of the board; accessory contains auxiliary contact and shunt release with voltage (AC230V).


Notice: 1. HU type only provides front wiring of 3P.

TMF Protection unit

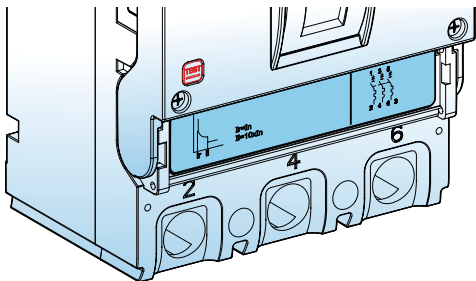

TMF: Thermal magnetic protection unit (For power distribution protection)


TMF Sign interpretation

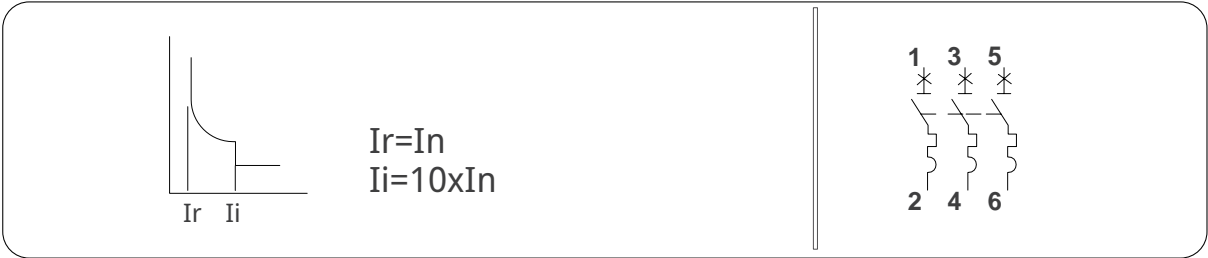

Protection curve

Protection unit type

TMF Protection characteristics

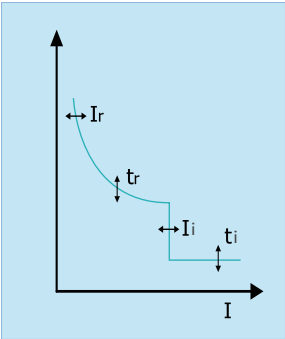

TMF: Data sheet of protection characteristics

Rated current(A)	Inverse time acting characteristic (Ambient air temperature +40°C)		Instantaneous acting current(A)
	1.05In(Cold state) Not acting time	1.3In(Hot state) Acting time	
In ≤ 63	≥ 1h	<1h	10In±20%
63<In ≤ 800	≥ 2h	<2h	

TMF Protection unit power loss

Power loss

Circuit Breaker Model	Rated current(A)	Total power loss of three-phase(W)	
		Wiring in front of the board, Wiring on back of the board	Plug-in / Wiring on back of the board
VM3-250	250	35	40
VM3-630	630	43	51


Derated coefficient of rated current

Circuit Breaker Model	+40°C	+45°C	+50°C	+55°C	+60°C	+65°C	+70°C
VM3-250	1.0 I _n	1.0 I _n	1.0 I _n	1.0 I _n	0.98 I _n	0.95 I _n	0.92 I _n
VM3-630	1.0 I _n	1.0 I _n	1.0 I _n	1.0 I _n	0.97 I _n	0.94 I _n	0.91 I _n

Derated coefficient of high altitude of VM3 series MCCB

Item	Parameter						
Elevation	2000	2500	3000	3500	4000	4500	5000
Power frequency withstand voltage(V)	3000	3000	2500	2400	2200	2200	2200
Isolation voltage	1	1	0.95	0.91	0.87	0.87	0.87
Breaking capacity correction factor	1	1	0.95	0.91	0.87	0.80	0.74
Working current correction factor	1	1	0.98	0.97	0.96	0.95	0.94

Electrical accessories



Alarm contact (AL)


Alarm contact (AL)

Function

The product outputs alarm signal when it is tripped by outer excitation signal due to overload, short circuit, undervoltage, or when the release button is pressed. This function is particularly useful in an automatic system, since that a fault signal can be sent to the designated place. And the fault signal will turn on due to an internal microswitch, when circuit breaker releases. But for normal opening or closing operations, it does not have any action.

Alarm contact operating characteristics

Circuit breaker status	Alarm contact status
The statuses of open and close	
The statuses of tripping	



Auxiliary contact (AX)

Auxiliary contact (AX)

Function

Auxiliary switch is used for indication of remote "ON" and "OFF". Each switch contains two contacts, which share a common end of connection. The ON/OFF position depends on the state of main contact. When the circuit breaker is open, one of them is normally open, and the other is closed, or vice versa.

Auxiliary contact operating characteristics

Circuit breaker status	Auxiliary contact status
The statuses of open	
The statuses of close	

Alarm contact,Auxiliary contact rated operational current

Classification	Rated current I_{nm}	Conventional thermal current $I_{th}(A)$	Rated working current $I_e(A)$	
			AC400V	DC220V
Auxiliary contact	≤ 250	3	0.3	0.15
	$400 \leq I_{nm} \leq 1000$	3	0.4	0.2
Alarm contact	$10 \leq I_{nm} \leq 1000$	-	AC220V/1.0A	0.15

ON-OFF capacity of Alarm contact and Auxiliary contact under normal conditions

Utilization category	ON				OFF				Number of operation cycles	Number of operation cycles per minute	Power time
	I/I_e	U/U_e	$\cos\phi$	$T_{0.95}$	I/I_e	U/U_e	$\cos\phi$	$T_{0.95}$			
AC-15	10	1	0.7	-	1	1	0.7	-	6050	6	$\geq 0.05s$
DC-13	1	1	-	$6 \times P_e$	1	1	-	$6 \times P_e$			$\geq 0.05s$

ON-OFF capacity of Alarm contact and Auxiliary contact under abnormal conditions

Utilization category	ON				OFF				Number of operation cycles	Number of operation cycles per minute	Power time
	I/I_e	U/U_e	$\cos\phi$	$T_{0.95}$	I/I_e	U/U_e	$\cos\phi$	$T_{0.95}$			
AC-15	6	1	0.7	-	1	1	0.7	-	10	6	$\geq 0.05s$
DC-13	1.1	1.1	-	$6 \times P_e$	1.1	1.1	-	$6 \times P_e$			$\geq 0.05s$


Note: 1. $T_{0.95}=6P_e$ is an empirical formula in which the unit of "Pe" is watt and the unit of $T_{0.95}$ is millisecond.

2. The number of operation of Auxiliary contact can equal to that of the circuit breaker, if the number of operation of circuit breaker is less than 6050.

3. The operation frequency and power-on time of an auxiliary contact are allowed to be the same as those of the main circuit.

4. If $T_{0.95}$ is more than 0.05s, the power-on time is at least $T_{0.95}$.

Electrical accessories



Shunt release (SHT)

Shunt release (SHT)


Function

Shunt release refers to the device which disconnect circuit breaker with current from a distance. A shunt release can cut off the signal circuit automatically after tripping.


Operating Characteristics

Voltage specification	AC50Hz: 110V 230V 400V DC: 24V 110V 220V
Operating characteristics	When the operation voltage is 70%~110% of the rated control voltage, the shunt release should trip the circuit breaker reliably.

Connection diagram (internal accessories of a circuit breaker)

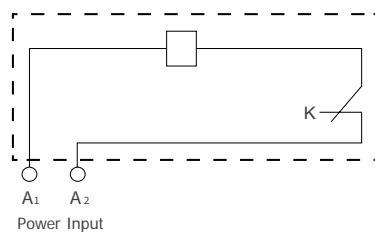

K is a microswitch closed contact of micro switch installed in series with the coil in shunt tripper, when the breaker is tripping, the switch is off by itself, when the breaker is closing, and then the switch is on.



Under-voltage release (UVT)

Under-voltage release (UVT)


Function

Under-voltage release is a device which can automatically disconnect the circuit breaker when voltage is reduced.

Operating characteristics of the under-voltage release

Rated operational voltage	AC400V AC230V
Operating Characteristics	<p>When the operation voltage is 70%~110% of the rated control voltage,the under-voltage should trip the circuit breaker reliably.</p> <p>When the working voltage is 85%~110% of the rated voltage, the under-voltage release should make the circuit breaker switch on.</p> <p>When the working voltage is less than 35% of the rated voltage, the under-voltage release should prevent the circuit breaker from being switched on.</p>

Wiring digram of under-voltage release module
(the internal accessories of circuit breaker are depicted in the dotted area)

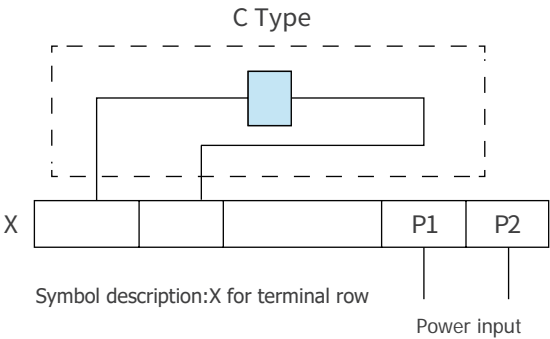

Under-voltage release power meter


Equipped with circuit breaker type	Under-voltage release power	
	AC230V	AC400V
VM3-630 (Thermal-magnetic)	0.75	0.75



Before switch on a circuit breaker, the undervoltage release must be electrified otherwise the circuit breaker may be damaged.

Electrical accessories (TMF)

Combined mode of electrical accessories

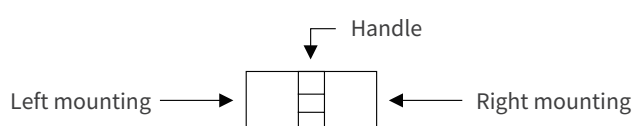


- Alarm switch
- Auxiliary switch
- Shunt release

- Under-voltage release
- Output lead direction

		Model	VM3-250	VM3-630
Accessory code	Accessory name	Poles	3	3、4 ^①
AL	Alarm contact			
AX	Auxiliary contact			
SHT	Shunt release		 ② ③	 ② ③
UVT	Under-voltage release			 ② ③
SHT + UVT	Shunt release and under-voltage release			 ② ③
AL+AX	Alarm contact and auxiliary contact			
AL+SHT	Alarm contact and shunt release		 ② ③	 ② ③
AL+UVT	Alarm contact and under-voltage release			 ② ③
AX+SHT	Auxiliary contact and shunt release		 ② ③	 ② ③
AX+UVT	Auxiliary contact and under-voltage release			 ② ③
AX+AL+SHT	Auxiliary contact, alarm contact and shunt release		 ② ③	 ② ③
AX+AL+UVT	Auxiliary contact, alarm contact and under-voltage release			 ② ③

Note: 1.If there is need to learn about the instructions of installation of accessories of a 4 poles circuit breaker, please contact with the manufacturer;
 2.If there is need for a UVT, a voltage module for the UVT is needed firstly(no voltage module is needed for a SHT).
 3.The standard installation of a SHT is the left pole installation, UVT is the right pole installation, please note if there is any special request.
 4.AL module of a VM3-630 product is special supply for the right pole installation, please contact with the manufacturer

Control accessories





Motor-operated mechanism (CD2)

Motor-operated mechanism (CD2)

Motor-operated mechanism which consists of an energy storage spring, an opening coil and a closing coil is used to control a circuit breaker from a distance. And a CD2 Motor-operated mechanism has the following features: CD2 type electric operating mechanism has

- The operation mode, manual or automatic mode, can be chosen.
- Hand drive handle is in front of a face cover.

The wiring diagram of a CD2 motor-operated mechanism is shown as following (internal accessories are indicated in the dotted square)

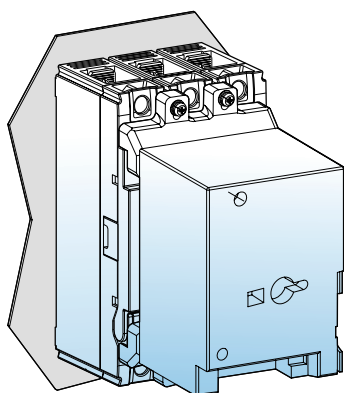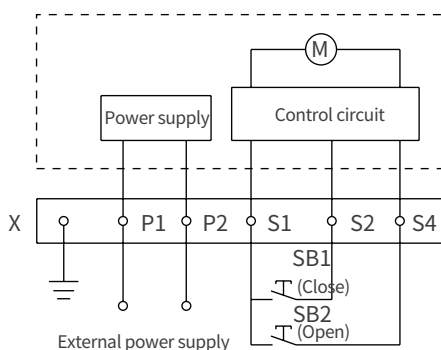


Manual operation

- The internal power supply is automatically closed, if the switch is operated to "manual" position.
- Put the handle into the slot in the front of an electric operating mechanism and then turn in a clockwise direction.
- Do not turn it in a counterclockwise direction.

Electric operation

- Auto connection
- Operating frequency should be no more than 3 times per minute.
- Using ON/OFF switches in the frequency range.
- Please do not input ON/OFF signal during automatic operation.
- Under-voltage release accessory(UVT) need to be applied a rated voltage before electric operation, if a Under-voltage release accessory(UVT) is mounted in a circuit breaker.


Motor-operated mechanism appearance

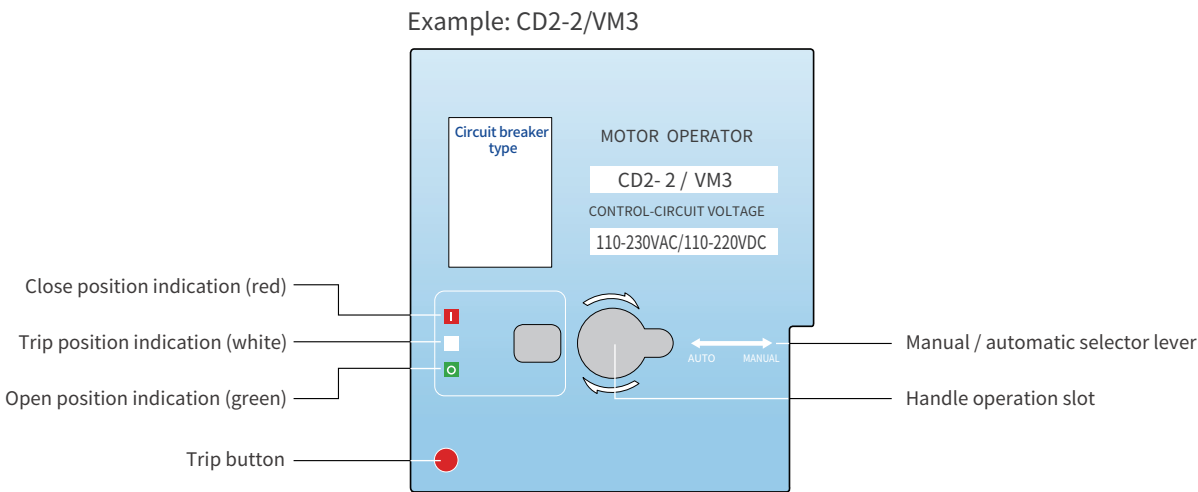

Acting Current, Motor Power and Longevity of CD2 type Power-driven Operating Mechanism

Equipped with circuit breaker type	Electric operating mechanism type	Control voltage	Starting current(A)	Response time(ms)		Power consumption	Durability
				Closed	Disconnect		
VM3-630 (Thermal-magnetic)	CD2-3	AC 110V/230V/400V DC 110V/220V/24V	≤ 0.5	500	350	14	10000

Note: After the circuit breaker trips,power-driven operating mechanism has to make the circuit reaker recramped,then it can be turned on.

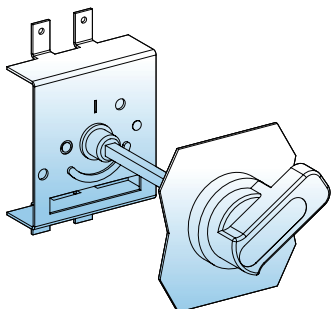


Rotary handle operator (CS1、CS2、CS3) *

With the unique design and transmission mechanism, the rotary handle operator can make the circuit breaker open, close and lock the tripping part by turning the handle.

Note: Rotary handle operator CS1、CS2、CS3 types details as P2-21 show



CS series rotary handle operator has the following features:

- Equipped with circular and square rotary operating handles.
- The panel sheet of the cabinet cannot be opened when the circuit breaker is on (i.e interlock with the door).
- The handle can related supporting drawers, and interlock with the drawer unit.
- If fault of the operation handle occurs during its closing state, the panel sheet can be opened by operating the emergency reliever.
- Extended rotary handle can be used and the length of the extension handle is determined according to the distance between the rotary handle and the door. The shortest and the longest are 150mm and 500mm

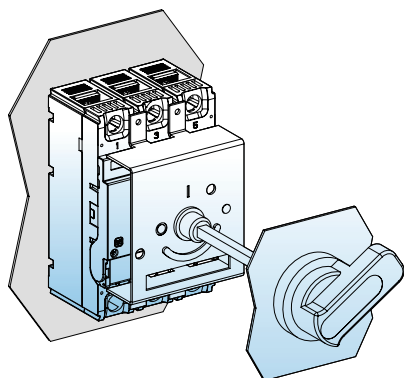


Classification


The rotary handle mechanism contains central type and eccentric type.
The rotary handle contains R type(circular) and F type(square).

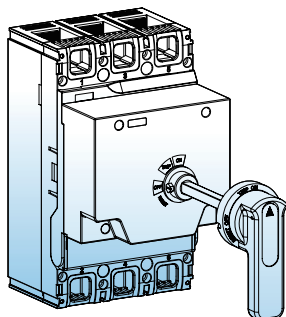

Connecting rod




F-type square handle



R-type round handle


Insulation accessories

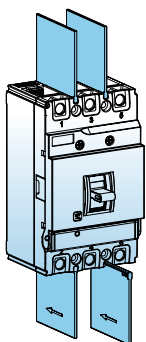



Phase separator

- The insulation strength can be enhanced by phase separators.
- It can be installed from a slot of a switch after the switch is mounted.
- It can be used with all the other accessories except long and short covers.


Thermal magnetic protection operating characteristic curve

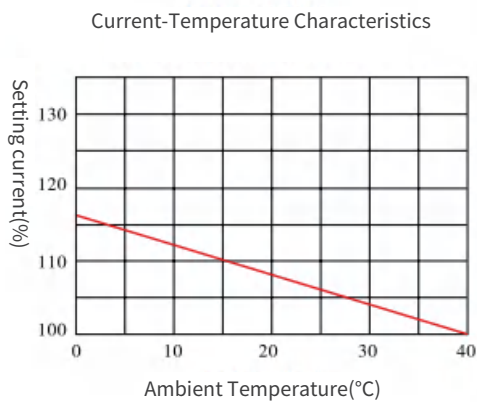


VM3-250 Time/Current Characteristic curve

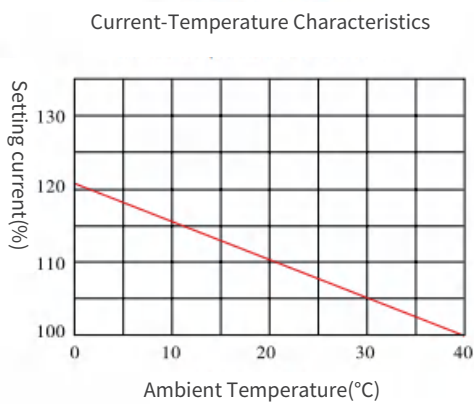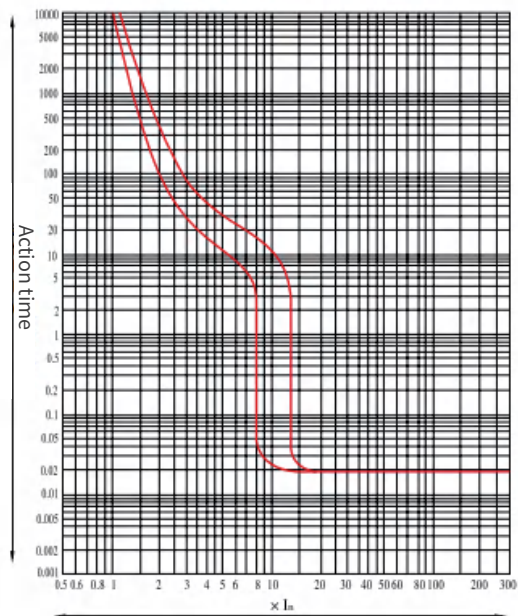


VM3-630 Time/Current Characteristic curve

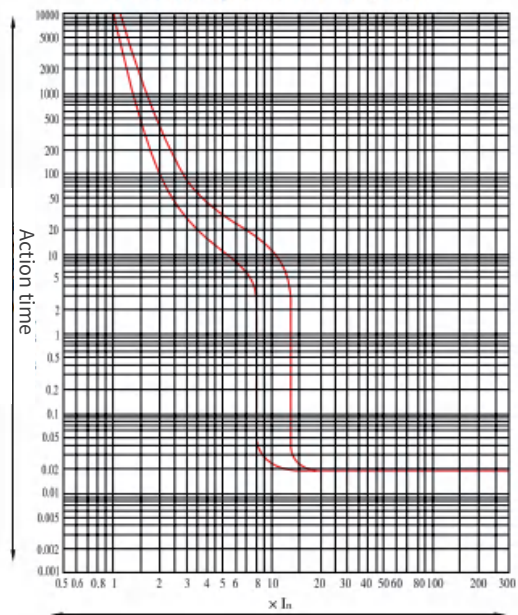


VM3-630HU series wiring in front of the board

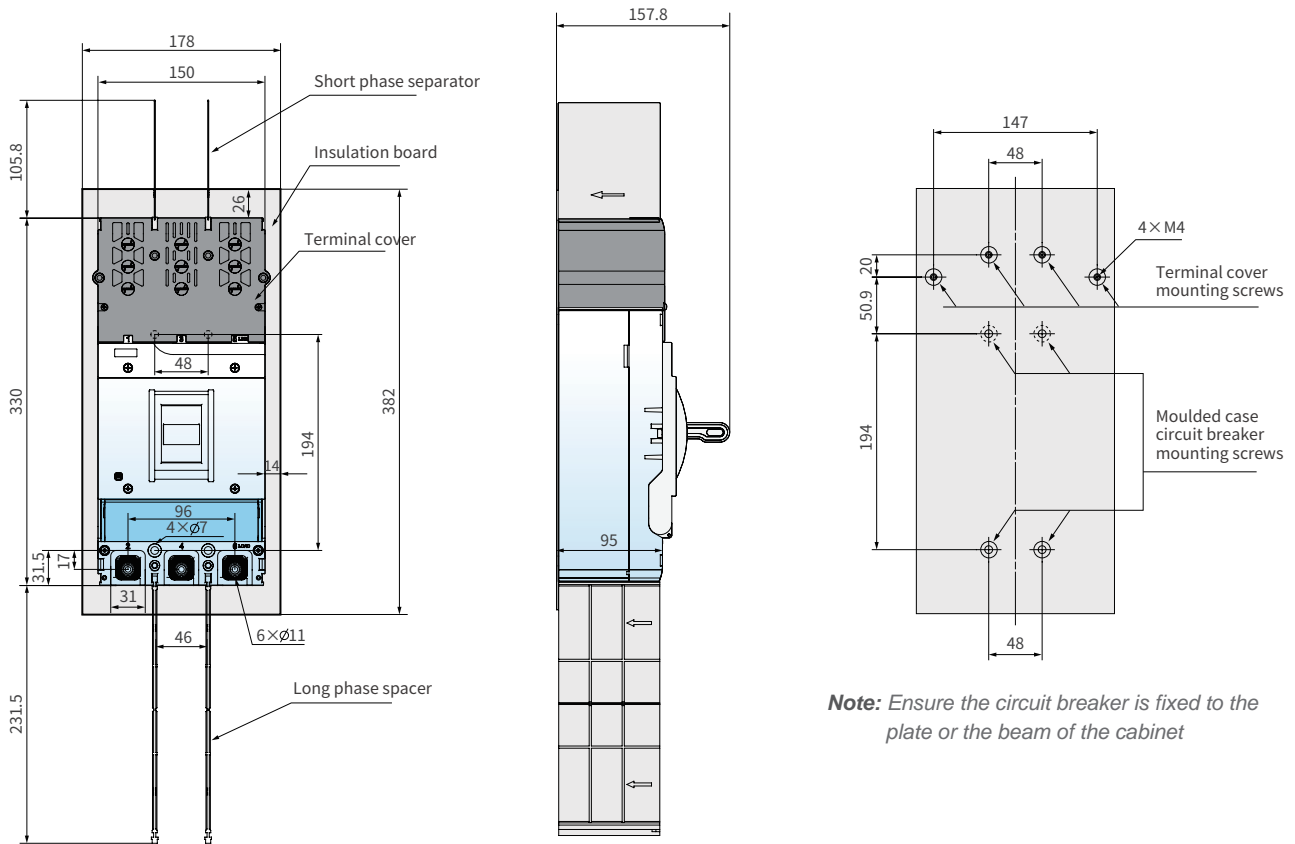

Connection terminal between poles

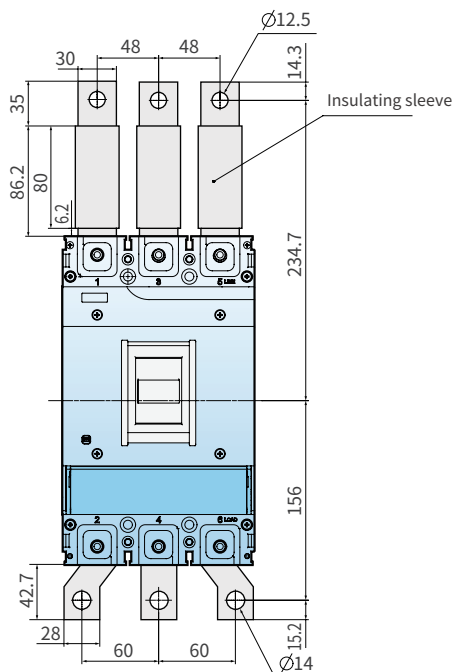


Straight Terminal Extender Connection

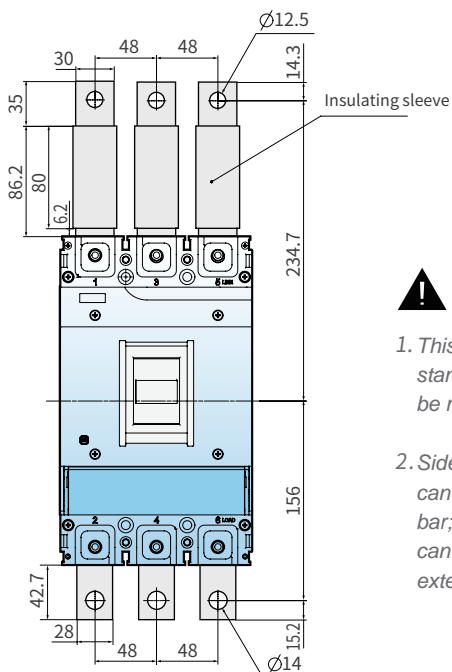


Note

1. This terminal expander is not standard matching and needs to be matched.
2. Sides 1,3,5 terminal expander can only be matched with straight bar; 2,4,6 terminal expander can choose both straight bar or extend bent bar.


VM3-250HU series wiring in front of the board

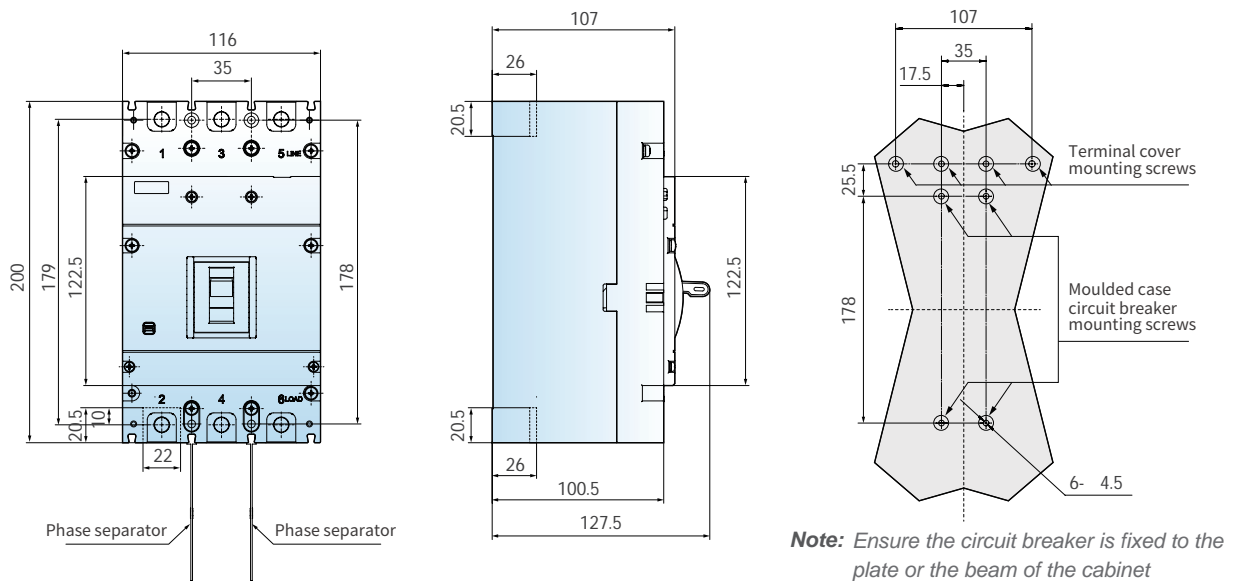

VM3-250HU dimensions with terminal cover

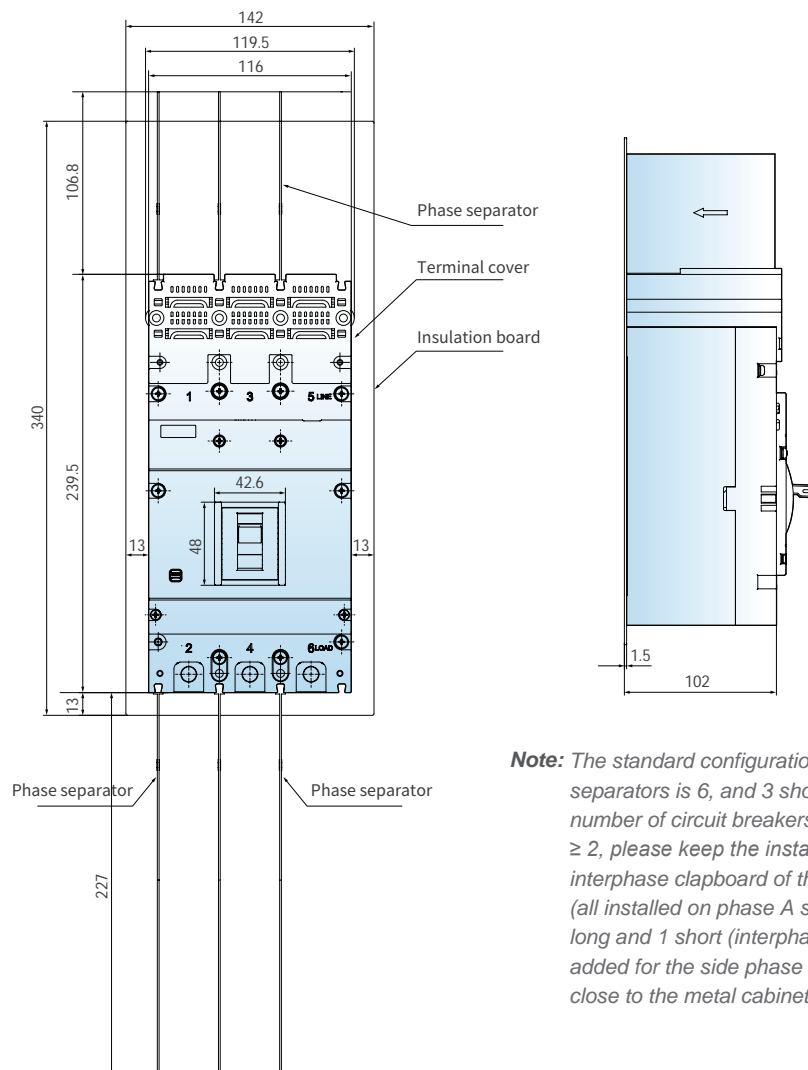

Installation diagram for VM3-630HU

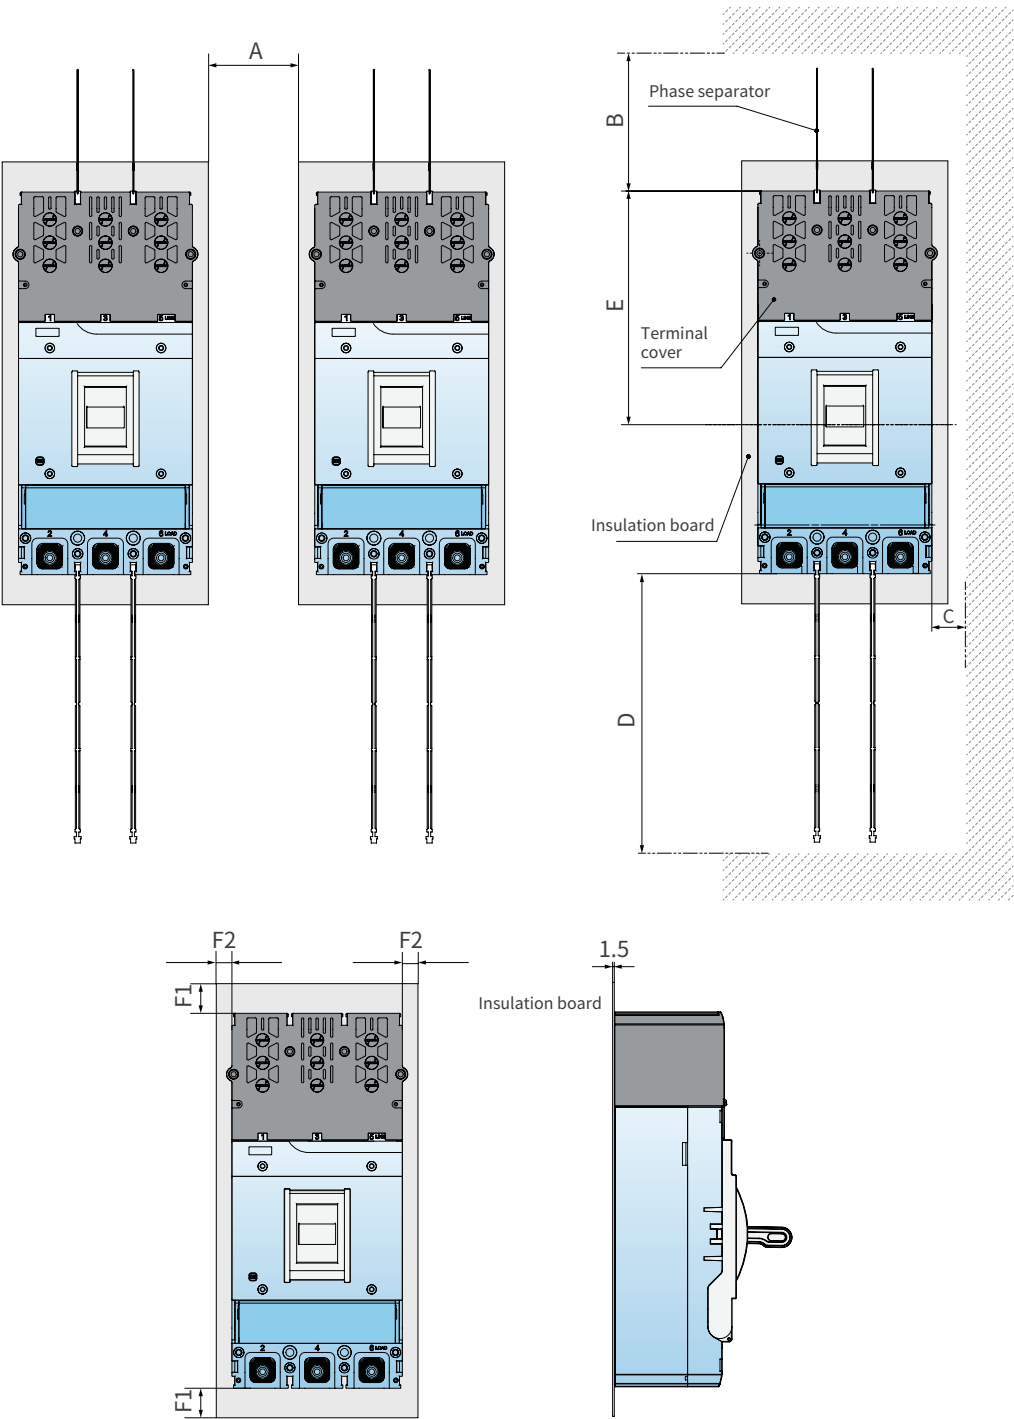


VM3 • Molded Case Circuit Breaker

Model	A	B	C	D	E	F1	F2
VM3-630HU	30	150	30	180	201.5	26	14


Note: When users use, terminals 1,3 and 5 of the circuit breaker connect to transformer side and install terminal cover and phase separator according to graphics. Terminals 2,4 and 6 connect to inverter side and install phase separator according to graphics. Insulation board is installed between circuit breaker and metal installation board.

Installation diagram for VM3-250HU


The minimum spacing between adjacent circuit breakers

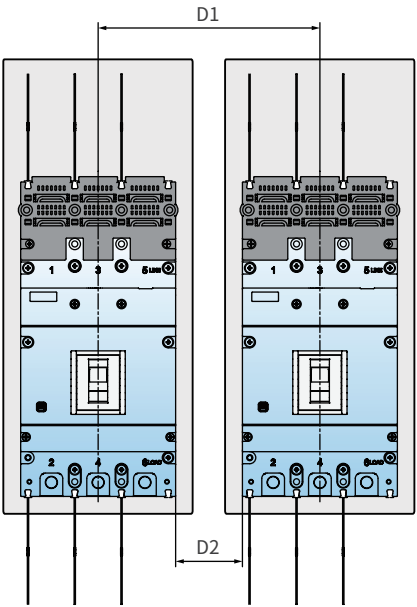


The minimum spacing of the top, baseplate and side plate of the circuit breaker

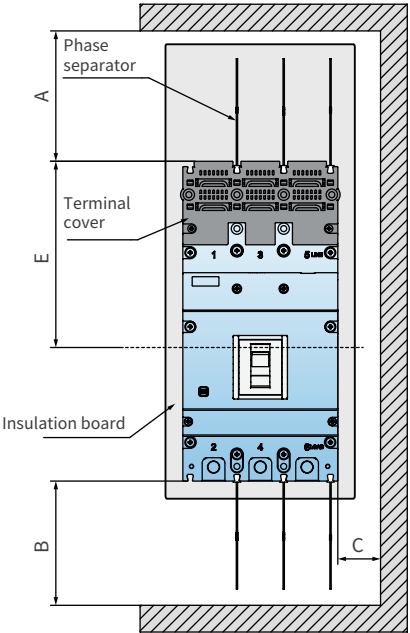

The minimum insulation length of wiring bar when it is front panel connection

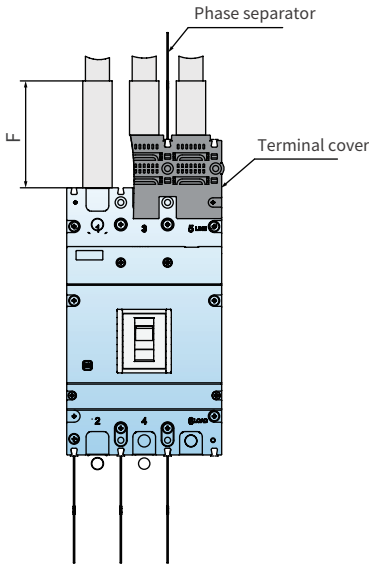


The minimum spacing between the circuit breaker and front panel

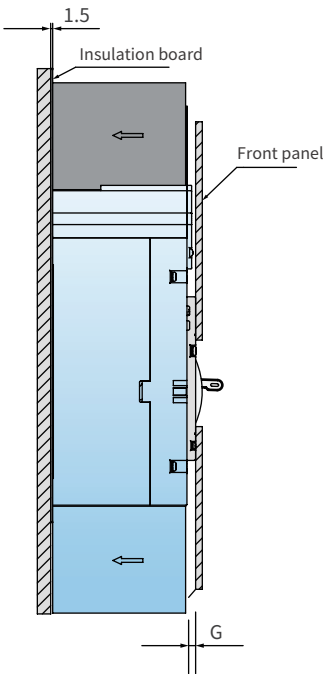

Model	Distance (mm)							
	A	B	C	D1	D2	E	F	G
								Insulation board Metal board
VM3-250HU	150	228	30	146	30	139.5	350	0 30


Note: When users use, terminal cover and phase separator should be assembled on terminals 1,3 and 5 of circuit breaker according to graphics. Phase separator should be assembled on terminals 2,4 and 6 of circuit breaker according to graphics. Insulation board is installed between circuit breaker and metal installation board.

Motor-operated mechanism

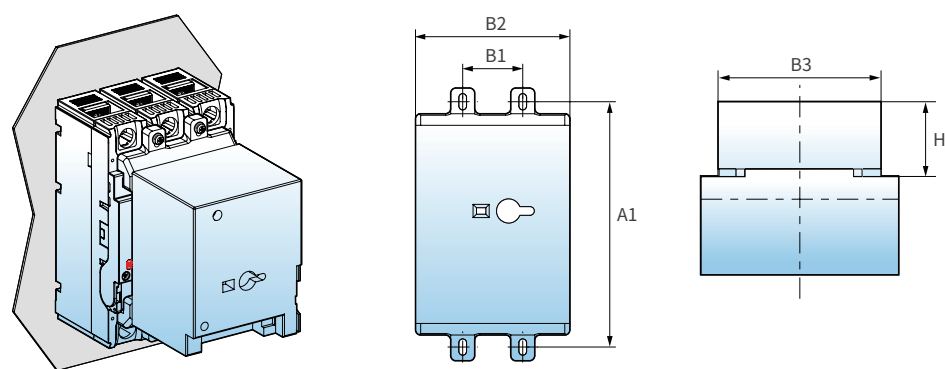

Motor-operated mechanism dimension table


Circuit breaker type	Motor operator model	A1	B1	B2	B3	H
VM3-630 (Thermal-magnetic)	CD2-3	194	48	129	175	156

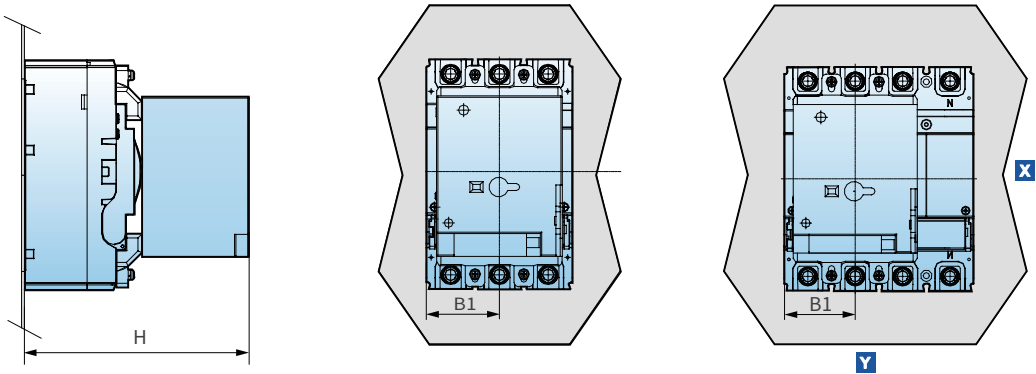

Model	B1	H
VM3-630 (Thermal-magnetic)	75	250.5

Extended rotary handle dimension

Centric

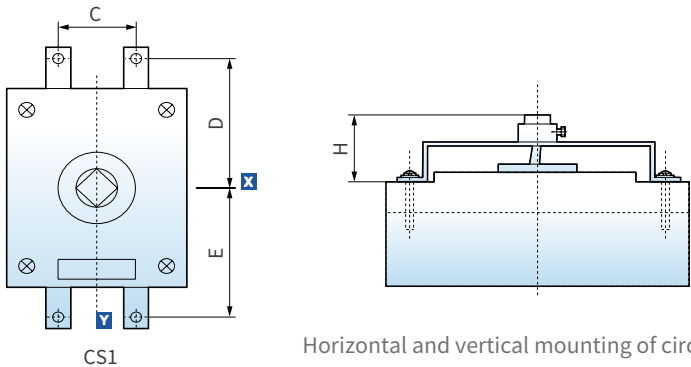


Horizontal and vertical mounting of circuit breaker

Centric size table

Model	Circuit breaker type	C	D	E	H	Remark
CS1-3	VM3-630 (Thermal-magnetic)	48	97	97	87	Used for vertical or horizontal installation of circuit breakers (centric trepanning)


Eccentric type

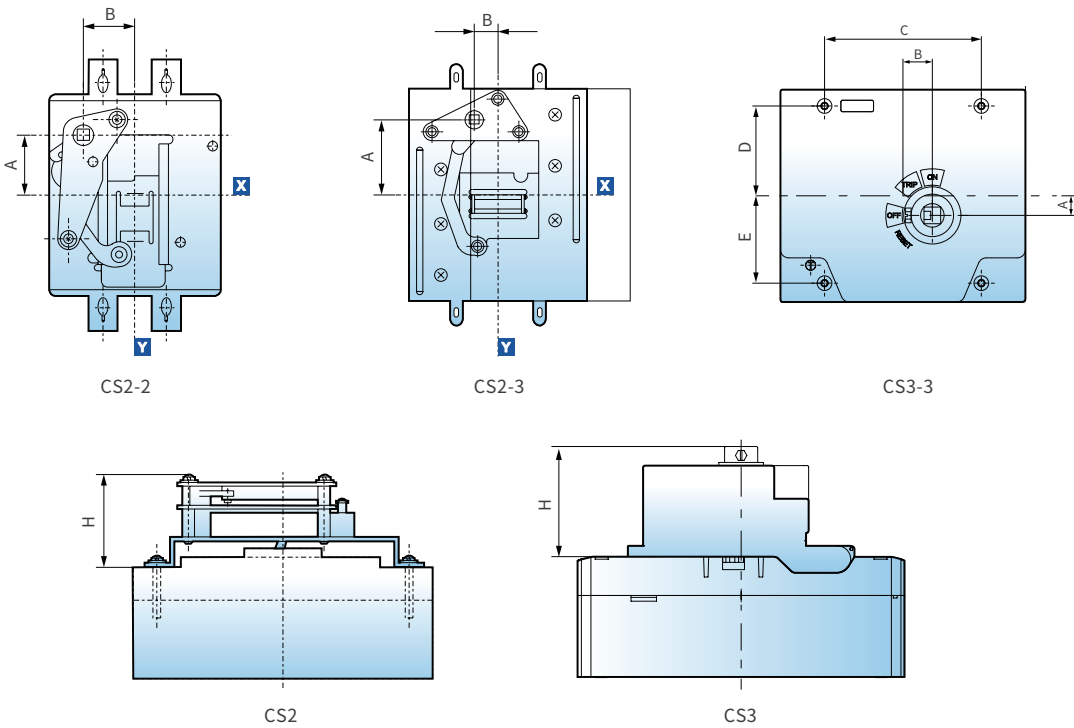

Eccentric size table

Model	Circuit breaker type	A	B	H	D	E	Remark
CS2-3	VM3-630 (Thermal-magnetic)	68	15	59			Used for vertical or horizontal installation of circuit breakers (eccentric trepanning)
CS3-3	VM3-630 (Thermal-magnetic)	12	18	86.5	55	53.5	

Extended rotary handle installation

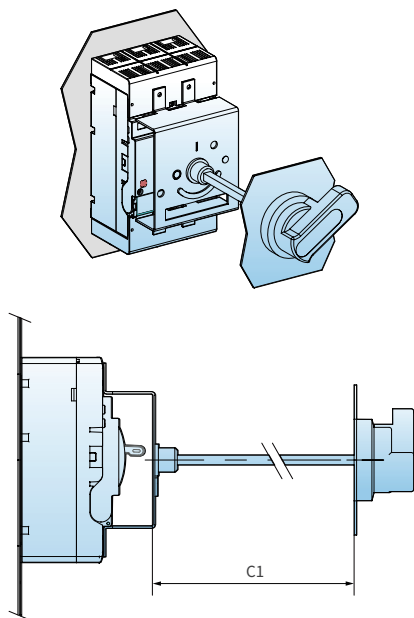


Circuit breaker model	C1	
	min	max
VM3-630	150	300


Extended rotary handle installation

Size and door sheet trepanning

F-type (F1 type used for VM3-250, F2 type used for VM3-630)

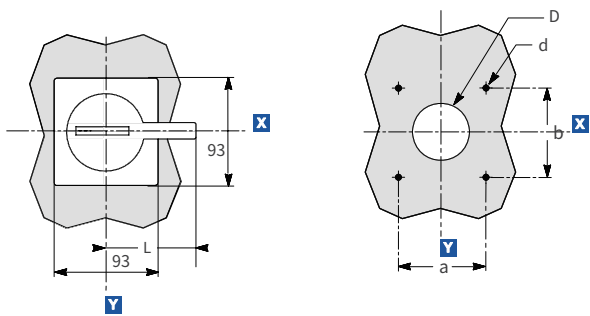

R-type (R1 type used for VM3-250, R2 type used for VM3-630)

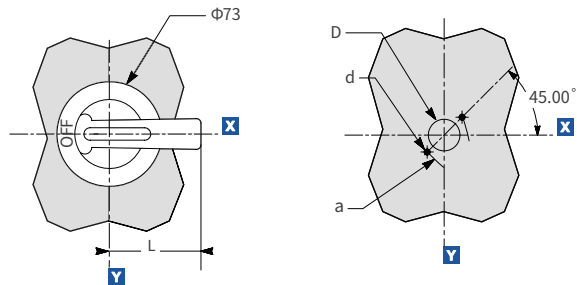

F-type

F type handle mounting dimensions

Handle specifications	F1	F2
D	φ 42	φ 42
d	φ 4.5	φ 4.5
a	65	65
b	65	65
L	65	95

R-type

R type handle mounting dimensions

Handle specifications	R1	R2
D	φ 34	φ 34
d	φ 5.5	φ 5.5
a	φ 53	φ 53
L	65	95

- Note:**
1. The standard configuration of CS1 and CS2 type rotating handle is R type and the length of square shaft is 200mm which connects rotary handle and the operating mechanism. Please specify if you have special requirement.
 2. For three pole and four pole circuit breakers, rotating handles have the same parameters.
 3. VM3-250 hand aperture dimensions refers to F1, R1 and VM3-630 aperture dimensions refers to F2, R2.